

Office Executive Engineer, Water Supply and Sanitation Division No. 3 SAS Nagar (Mohali)
(Near Ranbaxy Industry, Water Works, Industrial Area, Phase-1), SAS Nagar (Punjab)
Telephone and fax: 0172-2273894, e-mail eerwsmohali@yahoo.co.in

To

The Principal, Bhavan Vidyalaya,
Plot No. 4, Sector -13,
OMAXE, New Chandigarh.

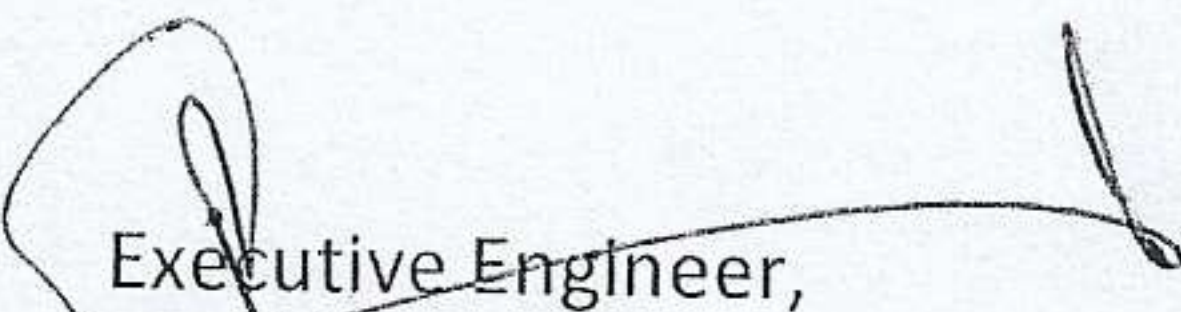
Letter No: 4088

Date: 18-05-2023

Subject: Request for the issuance for Health Sanitation and safe drinking water.

Reference: Your letter No. BVB/NEWCHD/2023-24/59 Dated 18-05-2023.


It is intimated that on the basis of test report of Water Sample conducted by Quality Manager Cum Director(WQ) RAWTL, DWSS Mohali (Punjab) the water is potable for drinking purposes and on the basis of recommendation of the concerned Sub Divisional Engineer Sub Division No. 8, SAS Nagar regarding Safety of Sanitation. On the above recommendation certificate is issued in this regard.

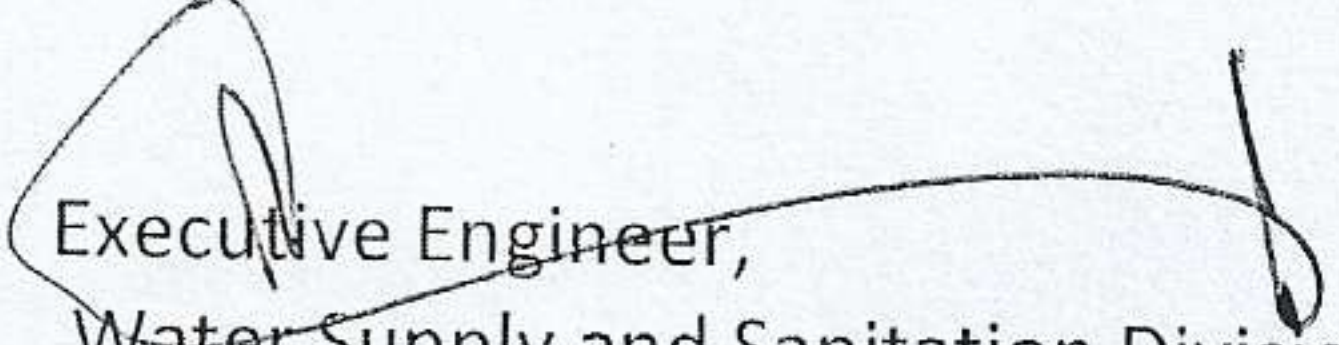

Executive Engineer,
Water Supply and Sanitation Division No. 3,
Sahibzada Ajit Singh Nagar (Mohali).

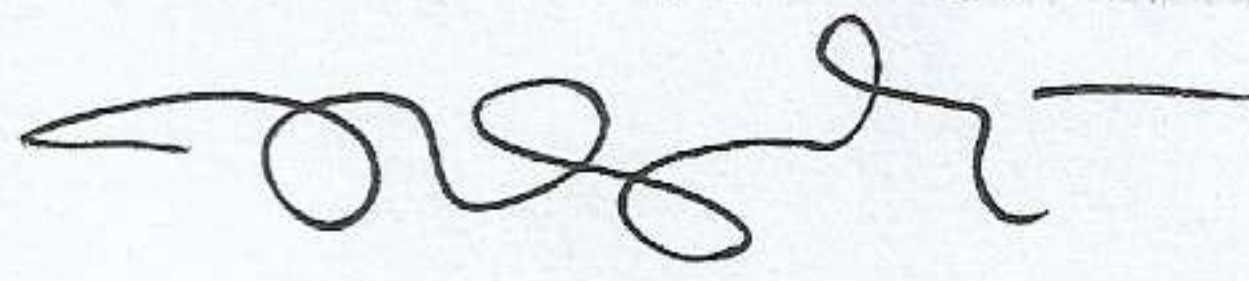
Endst No:

Date:

A Copy of the above is forwarded to the Sub Divisional Engineer, Water Supply and Sanitation, Sub Division No. 8, SAS Nagar for information.


Principal
Bhavan Vidyalaya
New Chandigarh


Executive Engineer,
Water Supply and Sanitation Division No. 3,
Sahibzada Ajit Singh Nagar (Mohali).


Secretary
Bharatiya Vidya Bhavan
Chandigarh Kendra



Punjab Biotechnology Incubator

Department of Science, Technology & Environment,
Govt. of Punjab

Notified State Analytical Agency

National Reference Laboratory of FSSAI | Approved as SIRO | PPCB Approved | Notified State Water Lab - GoP | OHSAS Certified

No.PBTIFA0/100523/001156 | 983

Dated : 18/05/2023
23/11/2023

ULR : TC611723000001136F

AMENDED TEST REPORT

Sample Registration No. : PBTI/FA0/100523/001156
Sample code given by customer : Ground Floor Near Staff Room

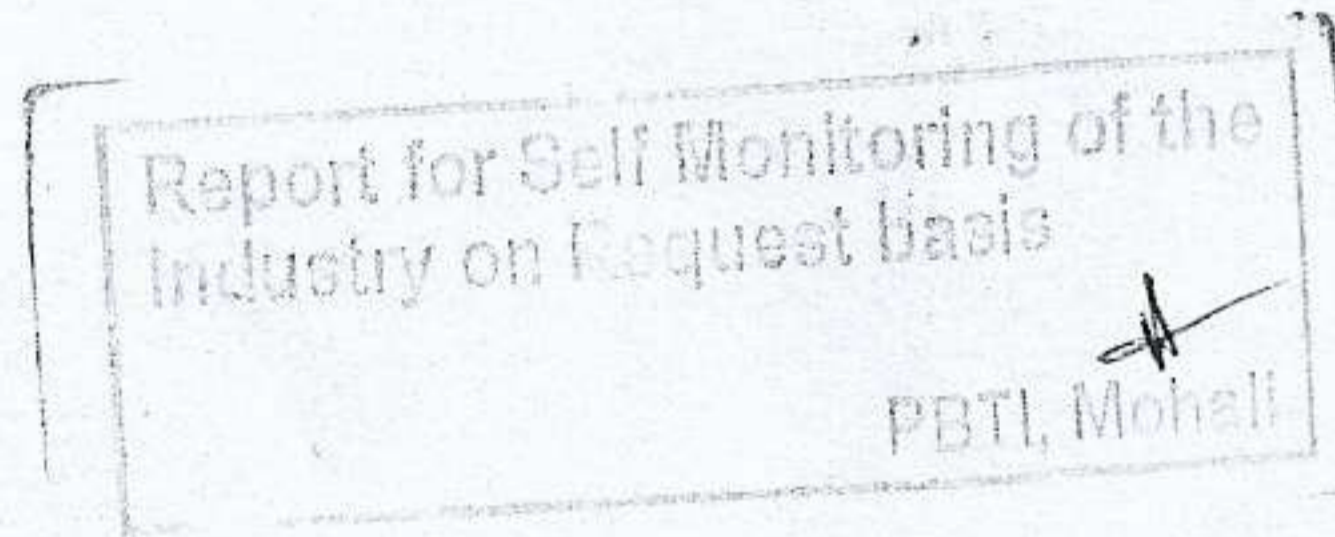
Issued to:

Bhavan Vidyalaya,
Plot No.4, Sector-13, Omaxe,

New Chandigarh.
Punjab

SAMPLE PARTICULARS

Your Ref. No. : Email Dt.03/05/2023 & Letter dt. 23/11/2023
Date & Time of Sample Collection : 10/05/2023 at 11:10am
Date & Time of Sample Receipt in Lab : 10/05/2023 at 2:20pm
Sample Identification No. : PBTI/100523/01,dt.10.05.23
Site of Sample Collection : **Bhavan Vidyalaya,** Plot No-4, Sector-13, Omaxe ,New chandigarh.
Name/Nature of sample : **Drinking water**
Type of Sample : Grab
Point of Sample Collection : From Water Cooler
Condition of the sample on Receipt : Intact coded sample under refrigerated conditions
Qty/Pkg. : 3.3L approx. in plastic & glass bottles
Sampling Method : Sample drawn by PBTI (Mr. Deerghayu) as per APHA guidelines
Test Start Date : 10/05/2023
Test Completion Date : 17/05/2023



[Signature]
23/11/2023
Authorized Signatory
Punjab Biotechnology Incubator Lab
Employee Code: 16

Note:

1. The above results pertain only to the sample tested.
2. There is no addition, deviation or exclusion from the method mentioned.
3. The report shall not be used for advertising or any legal purpose without written permission from the Chief Executive Officer, Punjab Biotechnology Incubator.
4. This report cannot be re-produced, except when in full, without the written permission from the Chief Executive Officer, Punjab Biotechnology Incubator.
5. Perishable samples will be destroyed after testing, others after one month from the date of issue of the report, unless otherwise agreed with the customer or as required by the applicable regulations.

Format No : PBTI/F/7.8/11
Issue No & Date : 01 & 12.08.2021

Page No. 1/2

[Signature]
Principal
Bhavan Vidyalaya
New Chandigarh

[Signature]
Secretary
Bharatiya Vidya Bhavan
Chandigarh Kendra

National Referral Lab for LMO/GMO Detection under Seeds Act 1966 | Referral Lab under Food Safety and Standards Act 2006

Knowledge City, Sector-81, SAS Nagar (Mohali) Punjab, India
Phone : +91-172-2998601, 2998602, 2998603, E-mail : pbt2005@yahoo.com
Website : www.pbttilabs.com /pbt_dst



Dated :

ULR : TC611723000001136F

Sample Registration No. : PBTI/FA0/100523/001156

Sample code given by customer : Ground Floor Near Staff Room

Test Results

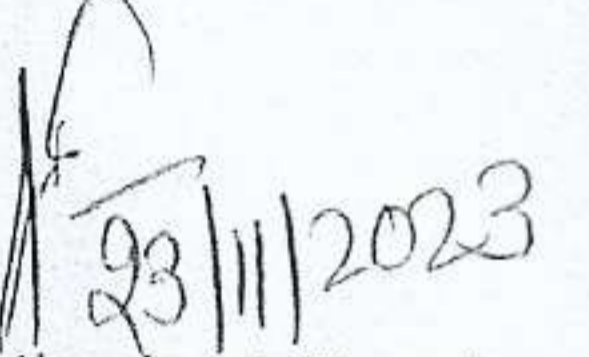
S.No.	Parameter	Requirement (Desirable Limit) As per IS 10500 : 2012)	Results	Units	Test Method
1	Color	Max 5	BDL(MDL:1)	Hazen	IS 3025 (Part 4) : 2021
2	Odour	Agreeable	Agreeable		IS 3025 (Part 5) : 2018
3	pH	6.5-8.5	7.98		IS 3025 (Part 11) : 2022
4	Taste	Agreeable	Agreeable		IS 3025 (Part 8) : 2017
5	Turbidity	Max 1	BDL(MDL:0.5)	NTU	IS 3025 (Part 10) 1984
6	Chloride (as Cl)	Max 250	9.2	mg/l	IS 3025 (Part 32) : 1988
7	Fluoride (as F)	Max 1	0.41	mg/l	IS 3025 (Part 60) : 2008
8	Residual free chlorine	Min 0.2 (For chlorinated supplies)	BDL (MDL:0.1)	mg/l	IS 3025 (Part 26) : 2021
9	Iron (as Fe)	Max 1	BDL(MDL 0.01)	mg/l	APHA 3125 B (By ICP-MS)
10	Hardness Total (as CaCO ₃)	Max 200	170	mg/l	IS 3025 (Part 21) : 2009
11	Coliform bacteria, MPN per 100 ml	Absent per 100ml	Absent	per 100 ml	IS 15185:2016
12	E.coli MPN per 100 ml	Absent per 100ml	Absent	per 100 ml	IS 15185:2016

Note: The test report is amended on account of Correction in the spelling of "Vidyalaya". Please refer the Old Test Report no.

PBTI/FA0/100523/001156/983, Dated 18.05.2023

BDL:Below Detection Limit

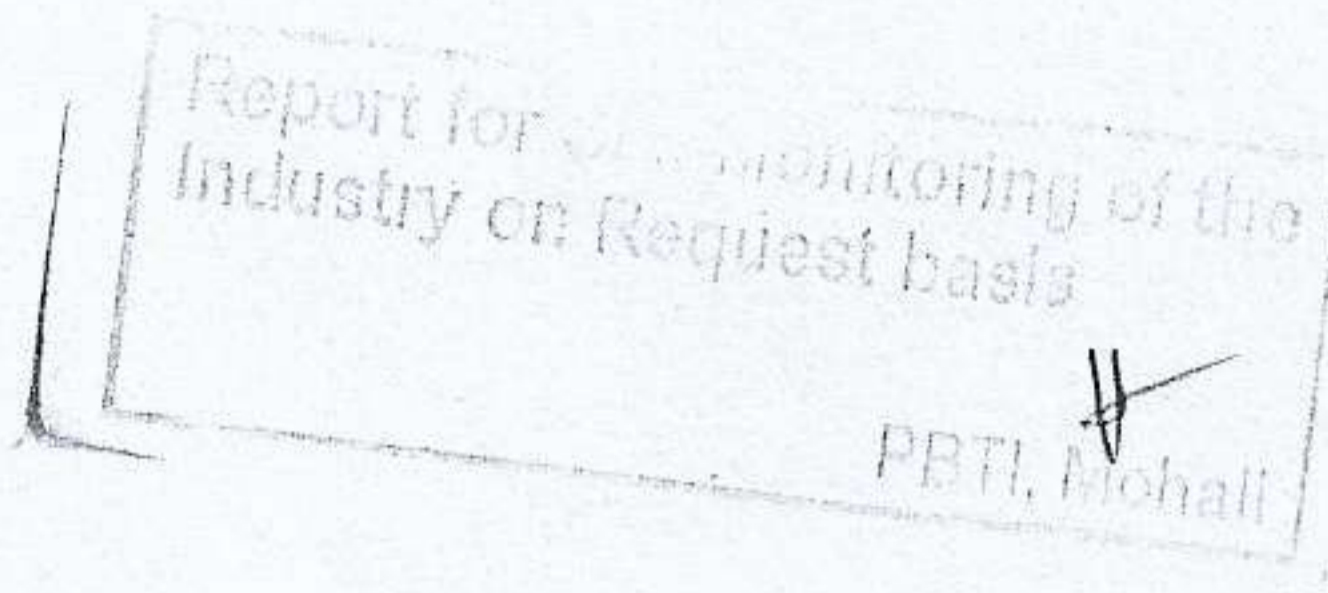
MDL:Method Detection Limit



23/11/2023


Authorized Signatory

Punjab Biotechnology Incubator Lab

Employee Code: 16




Principal
Bhavan Vidyalaya
New Chandigarh


Secretary
Bharatiya Vidya Bhavan
Chandigarh Kendra